




2700 Series Self-Regulating Heating Cable

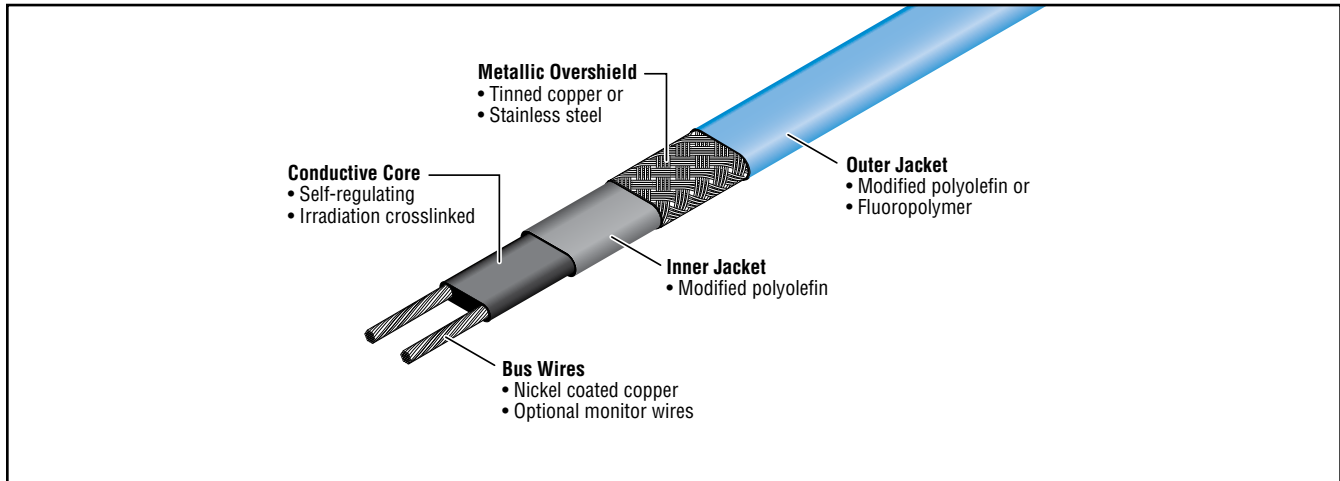

Description

Dekoron® Self-Regulating Heating Cables distributed by Heat-Line are designed to supply a specified amount of heat at any point along their length in direct response to local temperature variations. These cables can maintain temperatures up to 150°F (65°C) and survive intermittent exposure up to 185°F (85°C) with power applied.

The Dekoron 2700 series of self-regulating heating cables distributed by Heat-Line are designed to supply a specified amount of heat at any point along their length in direct response to local temperature variations. These cables can maintain temperatures up to 150°F (65°C) and survive intermittent exposure up to 185°F (85°C) with power applied.

Dekoron 2700 series cables can be cut to length and terminated in the field, and will not overheat or burnout when overlapped.

Applications

The industrial grade 2700 cables provide freeze protection and process temperature maintenance for fluid transport and storage systems. The bus wires, jackets and metallic braids can be configured for both ordinary (non-classified) and hazardous (classified) locations, including areas where exposure to corrosive or organic materials is possible.

Accessories

Heat-Line carries a full line of approved Dekoron accessories, including power connection kits, terminations, splices, end seals, and controls.

Performance Ratings

Output wattage	3, 5, 8, 10 w/ft @ 50°F (10°C)
Supply voltages	110 – 120 Vac or 208 – 277 Vac
Continuous maintenance temp.	150°F (65°C) max
Intermittent exposure temp.	185°F (85°C) max
T Rating*	T-5 (10 w/ft), T-6 (3, 5, 8 w/ft)
Braid resistance	
Tinned copper	0.003 Ω/ft
Stainless steel	0.125 Ω/ft

*T-Rating per the 1999 NEC, Tables 500-5(d) and verified by FM and CSA.

Approvals / Certifications



Ordinary locations

Hazardous locations

Class I, Div 1* / 2, Groups A, B, C, D
Class II, Div 1* / 2, Groups E, F, G
Class III, Div 1* and 2



Ordinary locations

Hazardous locations

Class I, Div 1* / 2, Groups B, C, D
Class II, Div 2, Groups F, G
Class III, Div 1* and 2




Roof and Gutter

Hot Water Maintenance



*Contact Heat-Line representative for information on Division 1 hazardous location systems.

Power Output Curves

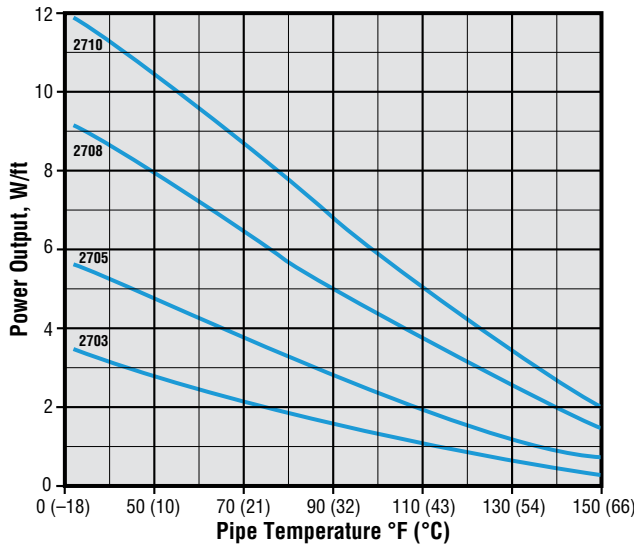

Product Ordering Information

(Example:
5 watt, 120 volt, tinned copper braid) **2705 - 1 1 C 00**

Series _____
27 = 2700

Output _____
03 = 3w
05 = 5w
08 = 8w
10 = 10w

Voltage _____
1 = 120 Vac
2 = 240 Vac

Class _____
1 = Ordinary/Div. 2
3 = Ordinary/Div. 2 w/monitor wires
4 = Class I, Div. 1

Braid Option _____
C = Tinned copper
S = Stainless steel
T = Tinned copper w/flouropolymer jacket
R = Tinned copper w/modified polymer jacket

Reserved _____

120 Volt Breaker Sizing vs. Max Circuit Length (ft)

		15A	20A	30A	40A
2703-1 If started at:	50°F (10°C)	300	-	-	-
	0°F (-17°C)	200	270	330	-
	-20°F (-29°C)	180	230	330	-
2705-1 If started at:	50°F (10°C)	230	270	-	-
	0°F (-17°C)	150	200	270	-
	-20°F (-29°C)	130	175	260	270
2708-1 If started at:	50°F (10°C)	150	200	210	-
	0°F (-17°C)	95	125	190	210
	-20°F (-29°C)	85	100	170	210
2710-1 If started at:	50°F (10°C)	115	150	180	-
	0°F (-17°C)	70	95	145	180
	-20°F (-29°C)	60	85	120	165

240 Volt Breaker Sizing vs. Max Circuit Length (ft)

		15A	20A	30A	40A
2703-2 If started at:	50°F (10°C)	660	-	-	-
	0°F (-17°C)	410	560	660	-
	-20°F (-29°C)	360	480	660	-
2705-2 If started at:	50°F (10°C)	460	540	-	-
	0°F (-17°C)	300	400	540	-
	-20°F (-29°C)	260	345	520	540
2708-2 If started at:	50°F (10°C)	295	390	420	-
	0°F (-17°C)	195	250	375	420
	-20°F (-29°C)	170	225	340	420
2710-2 If started at:	50°F (10°C)	230	305	360	-
	0°F (-17°C)	150	200	300	360
	-20°F (-29°C)	130	175	260	360

Note: Recommended circuit breakers to minimize the effect of transit start-up currents. Westinghouse: Types BA, EB, EHB, FB, HFB. General Electric: E100 Type TEB, E150, Types TED, THED. Square D: Types EH, FAIF. **The Canadian Electrical Code and National Electric Code requires ground fault protection of equipment for each branch circuit supplying electrical heating cables or devices.**

Power Adjustment Factor

Part No.	208 Volts	277 Volts
2703-2	0.75	1.28
2705-2	0.86	1.16
2708-2	0.91	1.10
2710-2	0.93	1.08

Heat-Line is a trademark of Heat-Line Corporation. All other trademarks are the property of their respective owners.

Heat-Line

A division of Christopher MacLean Ltd.

1095 Green Lake Road
Carnarvon, ON Canada
K0M 1J0

Tel: (705) 754-4545
(800) 584-4944
Fax: (705) 754-4567
info@heatline.com
www.heatline.com

Important: All information, including illustrations, is believed to be reliable. Users, however, should independently evaluate the suitability of each product for their particular application. Heat-Line a Division of Christopher MacLean Ltd. makes no warranties as to the accuracy or completeness of the information, and disclaims any liability regarding its use. Heat-Line's only obligations are those in the Heat-Line Standard Terms and Conditions of Sale for this product, and in no case will Heat-Line be liable for any incidental, indirect, or consequential damages arising from the sale, resale, use, or misuse of the product. Specifications are subject to change without notice. Heat-Line reserves the right to make changes —without notification to Buyer—to processing or materials that do not affect compliance with any applicable specification. All heating cable products and or accessories presented in this document are distributed through Heat-Line a division of Christopher MacLean Limited in accordance with Heat Trace Products, LLC, the manufacturer.